

SNMP Web Manager

User's Manual

Table of Contents

1. Introduction.....	2
2. SNMP Web Manager Install, Quick Start and Uninstall.....	2
2.1. Software Installation.....	2
2.2. Software Quick Start.....	6
2.3. Software Uninstall	6
3. SNMP Web Manager GUI	7
3.1. SNMP Device List.....	7
3.2. Scan	7
3.3. Add IP Address.....	8
3.4. Delete IP Address.....	8
3.5. Open web server page.....	8
3.6. SNMP Status	10
3.7. Reset	10
3.8. Use system time.....	13
4. SNMP Web Manager Function Menu	14
4.1 System.....	14
4.1.1 Quit	14
4.2 Settings.....	14
4.2.1 Basic Info.....	14
4.2.2 IP Setting.....	15
4.2.3 Online upgrade.....	17
4.2.4 System manager	20
4.2.5 Static trap address.....	21
4.2.6 SMS Configuration.....	21
4.3 Language	25
4.4 Help.....	25

1. Introduction

SNMP Web Manager is a configuration wizard to configure SNMP web card on the computer. For the detailed supported operation systems, please check the next chapter. Users can search and configure all SNMP devices in the LAN via the SNMP interface.

2. SNMP Web Manager Install, Quick Start and Uninstall

Supported OS:

- Windows Server 2012 / 2016 / 2019 (32 bit & 64 bit)
- Windows 7 / 8 / 10 (32 bit & 64 bit)
- Windows SBS 2011 (32 bit & 64 bit)
- Linux RedHat Enterprise AS3 / AS5 / 5 / 8 /9 (32 bit)
- Linux RedHat Enterprise AS6 (32 bit & 64 bit)
- Linux Cent OS 5 / 6 / 7 (32 bit & 64 bit)
- Linux Cent OS 8 (64 bit)
- Linux Ubuntu 8 / 9 (32 bit)
- Linux Ubuntu 11 /18 / 19 / 20 (64 bit)
- Linux Ubuntu 10 / 12 / 14 / 15 / 16 (32 bit & 64 bit)
- Linux Mint 14.x /19.x (32 bit)
- Linux Mint 19 / 20 (64 bit)
- Linux Fedora 5 / 17 (32 bit & 64 bit)
- Linux Fedora 33 (64 bit)
- Linux OpenSUSE 10 / 11 / 12 / 13 (32 bit & 64 bit)
- Linux Debian 6.x / 8.x /10.x (32 bit)
- Linux Debian 6 / 7 / 8 / 10 (64 bit)
- Mac OS 10.6 / 10.7/ 10.8/ 10.9/ 10.10/ 10.11/ 10.12/ 10.13/ 10.14/ 10.15/ 11.0 (64 bit)

2.1. Software Installation

Step 1: Click install file, it will display the installation in process. Refer to the diagram 2-1.

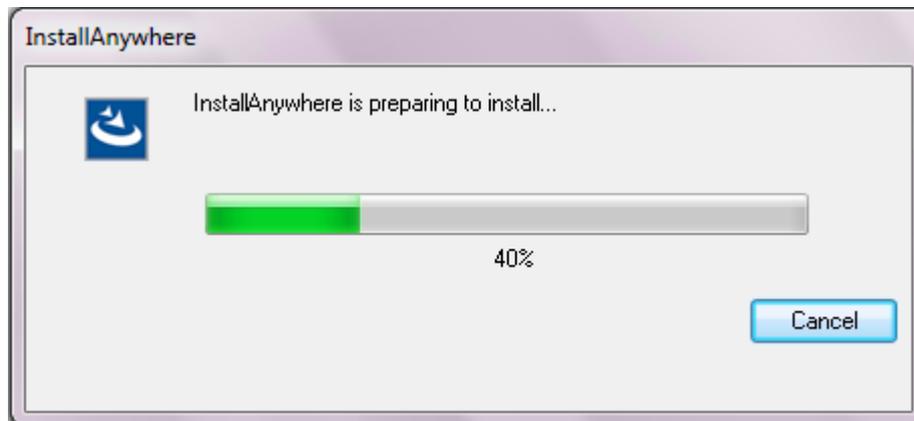


Diagram 2-1

Step 2: Click "Next" to proceed to the next screen as Diagram 2-2.

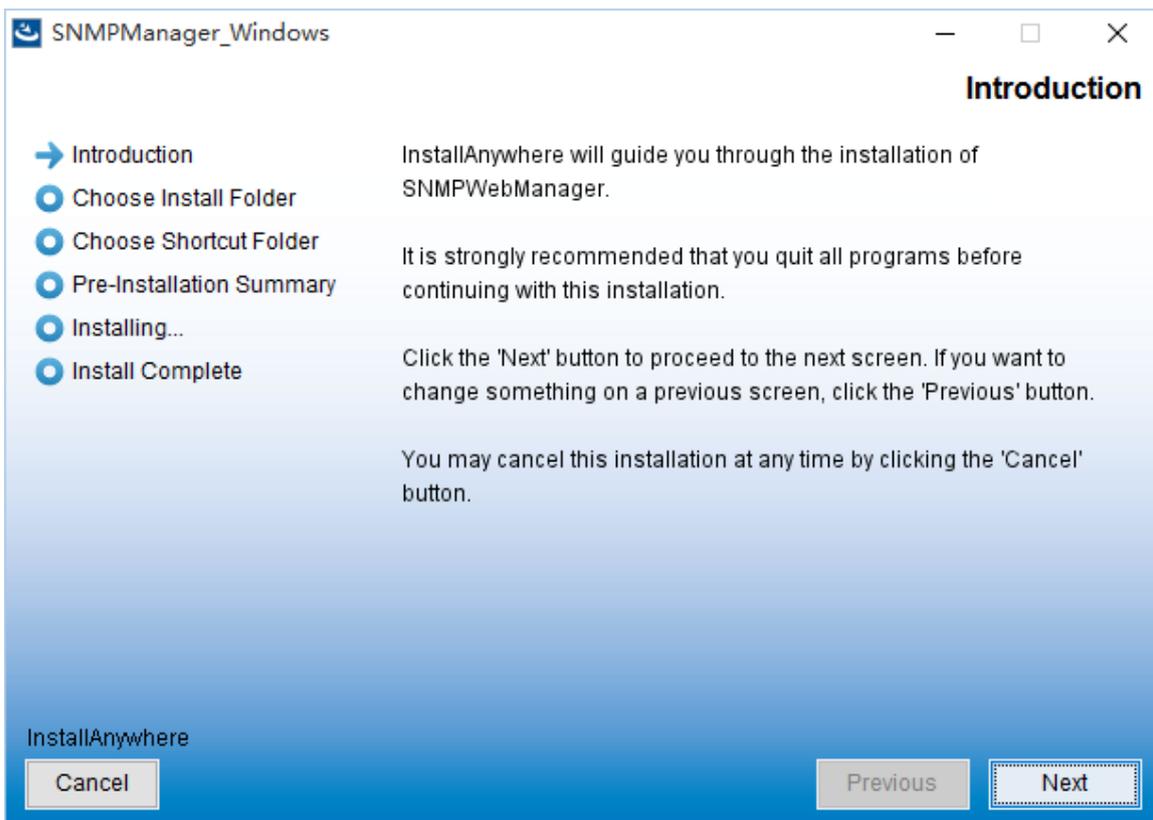


Diagram 2-2

Step 3: Click "Choose" button to change the default folder. After choosing the installed folder, click "Next" button. Refer to the following diagram 2-3.

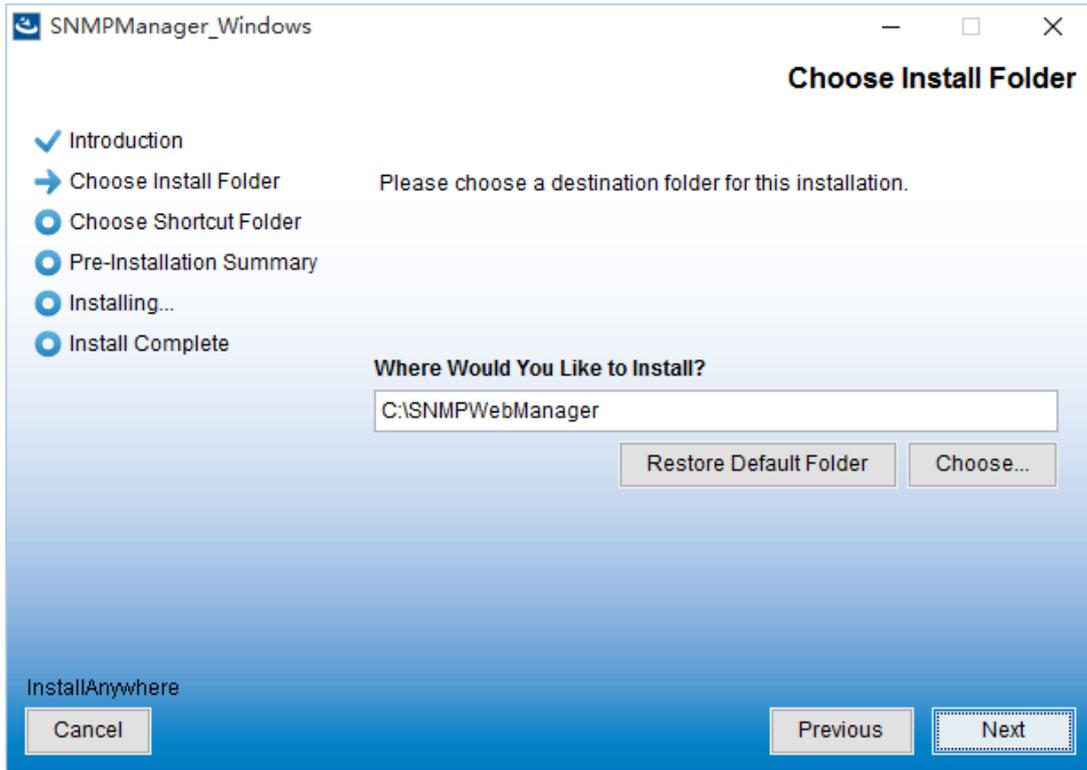


Diagram 2-3

Step 4: Choose the shortcut folder and click "Next" button. Refer to the following diagram 2-4.

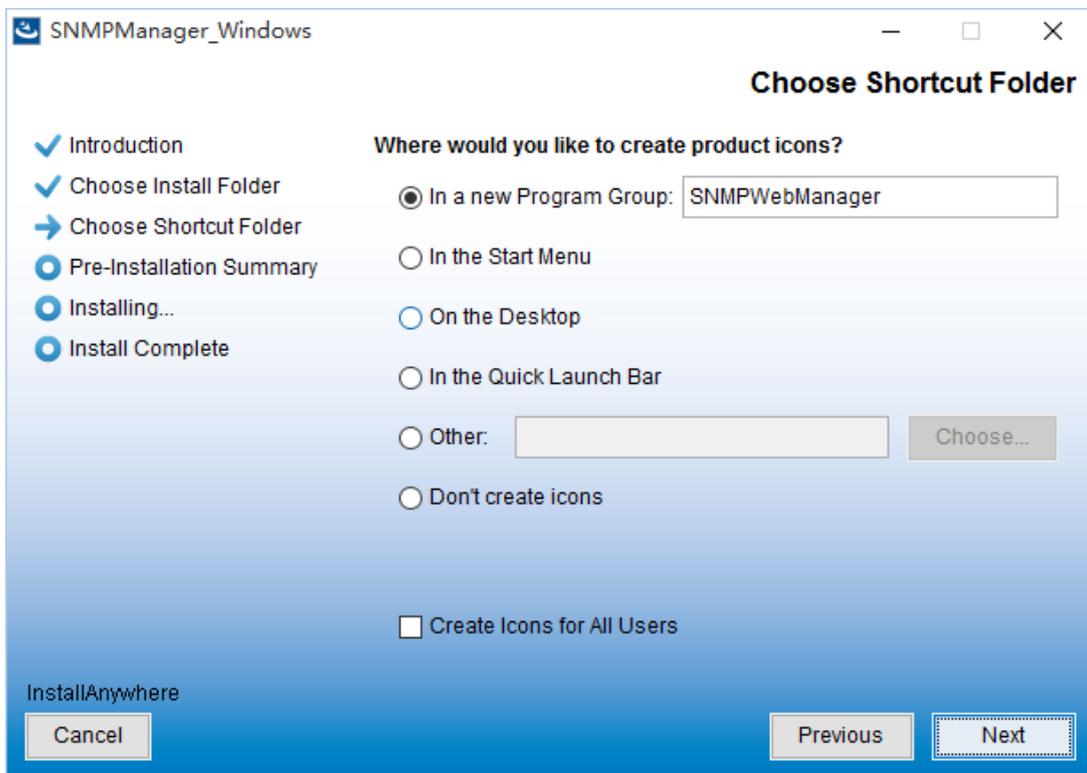


Diagram 2-4

Step 6: It will display the software summary before installation. Click "Install" button to start the installation and refer to Diagram 2-5.

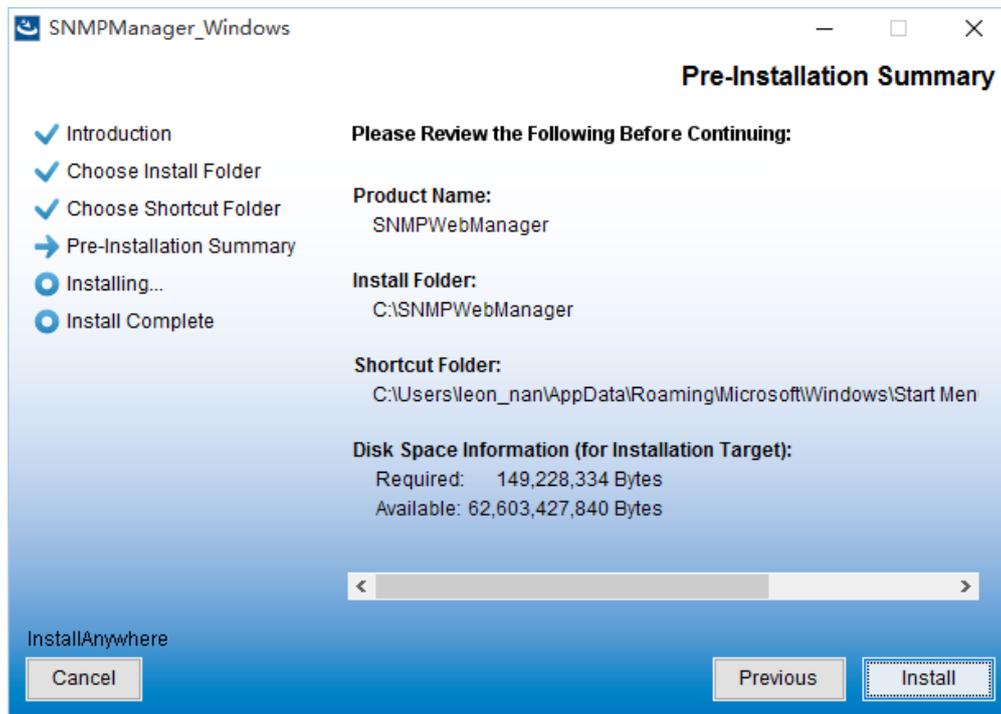


Diagram 2-5

Step 7: Click "Done" button to confirm the installation completely. Refer to Diagram 2-6.

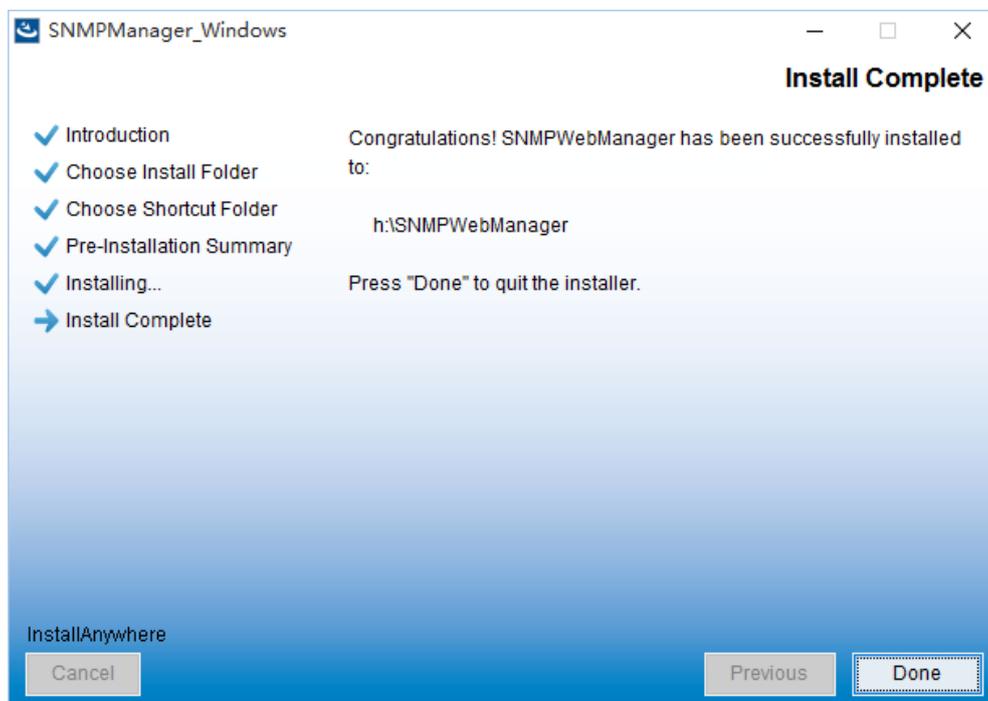


Diagram 2-6

Note: Please uninstall the previous version before installing the new version software.

2.2. Software Quick Start

The Installer will leave a shortcut icon on your desktop. Simply click the shortcut. Then it will start the software. Refer to the below diagram.

Or, use the Start Menu method; Start >> All Programs >> SNMP Web Manager >> SNMP Web Manager



Shortcut icon

2.3. Software Uninstall

Note: Before uninstalling software, you must stop all software programs first and then log in as "Administrator". Otherwise, it can't be uninstalled completely.

Please choose SNMP Web Manager >> Uninstaller.exe. Then follow the on-screen instruction to uninstall the software.

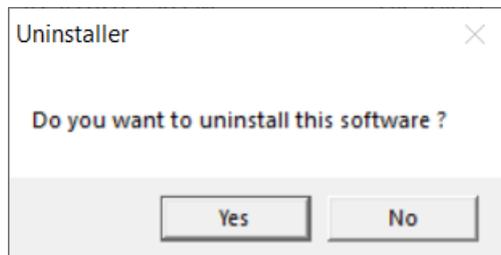


Diagram 2-7




Diagram2-8

3. SNMP Web Manager GUI

The GUI has four sections as marked in the illustration below:

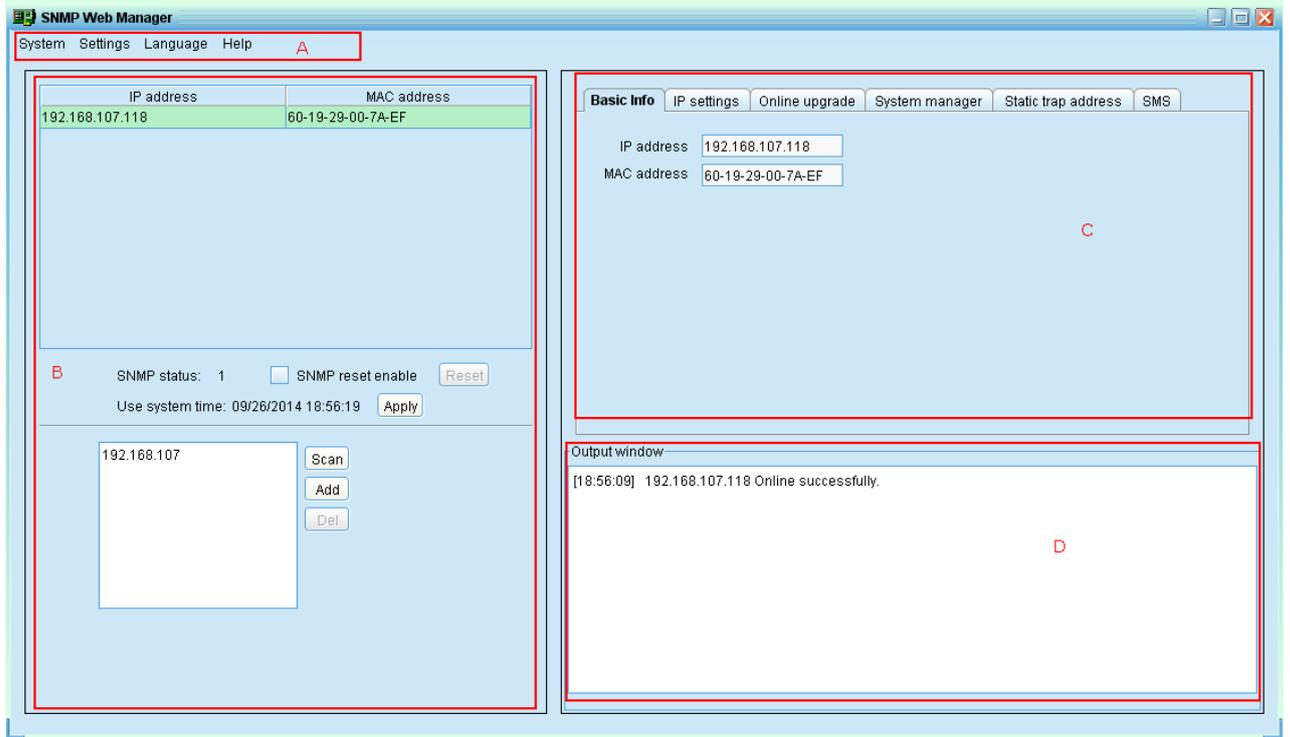


Diagram 3-1

A. Function menu offers a complete tool-set for navigating and setting the GUI.

B. SNMP device list can list down all SNMP devices located in the current IP address.

C. Configuration area includes IP settings, online upgrade, password management, and static trap address.

D. Output window displays all messages for operations

3.1. SNMP Device List

The default value in the window list would be a current PC IP address. For example, if the IP address of the current PC is "192.168.102.10", it will display "192.168.102" on the list when first enabling SNMP Web Manager.

3.2. Scan

You may enter specific IP address and then click "Scan" button to search.

3.3. Add IP Address

Click “Add” button and it will pop up a window to ask for entering specific IP address. Then, click “Apply” button to add the IP address (Subnet). Refer to Diagram 3-2.

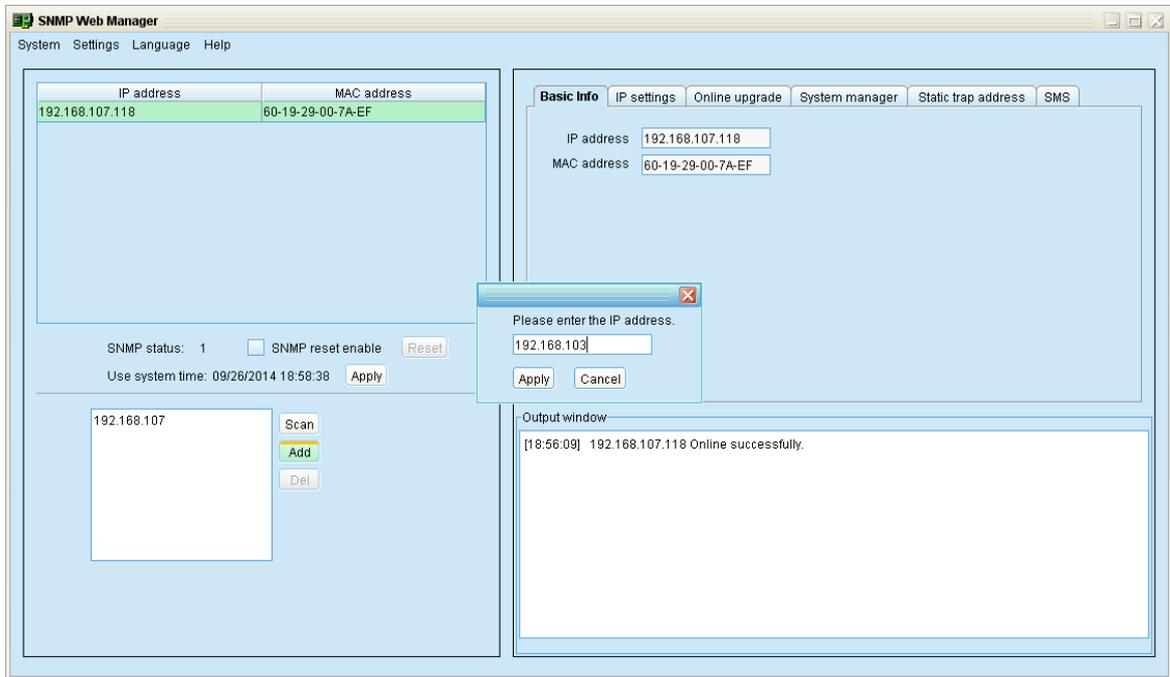


Diagram 3-2

3.4. Delete IP Address

Select the unnecessary IP address from list and click “Del” button to delete from the list.

3.5. Open web server page

Double click device list to open web server page. Refer to Diagram 3-3.

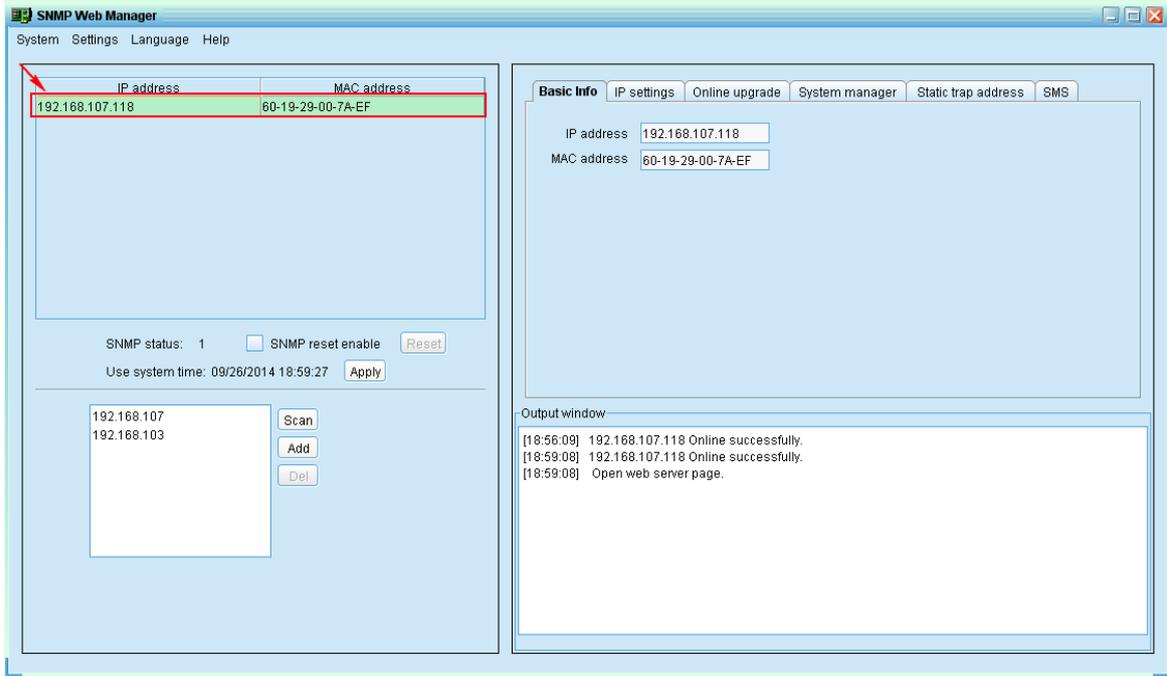


Diagram 3-3

You will see the SNMP web server page, Refer to Diagram 3-4.

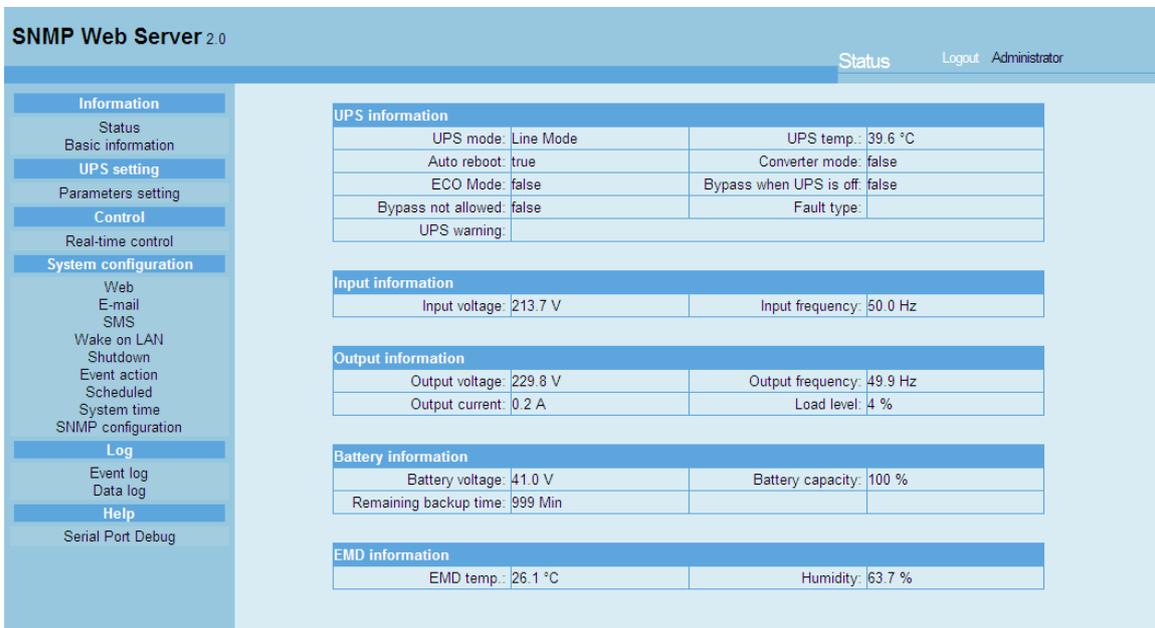


Diagram 3-4

3.6. SNMP Status

After one IP address is selected from the IP list, SNMP status will become 0 or 1. If the SNMP card has a program inside, the SNMP status becomes 1. If it has not programmed inside, SNMP status becomes 0. If none of any IP address is selected, SNMP status will display "---" as default. Refer to Diagram 3-5.

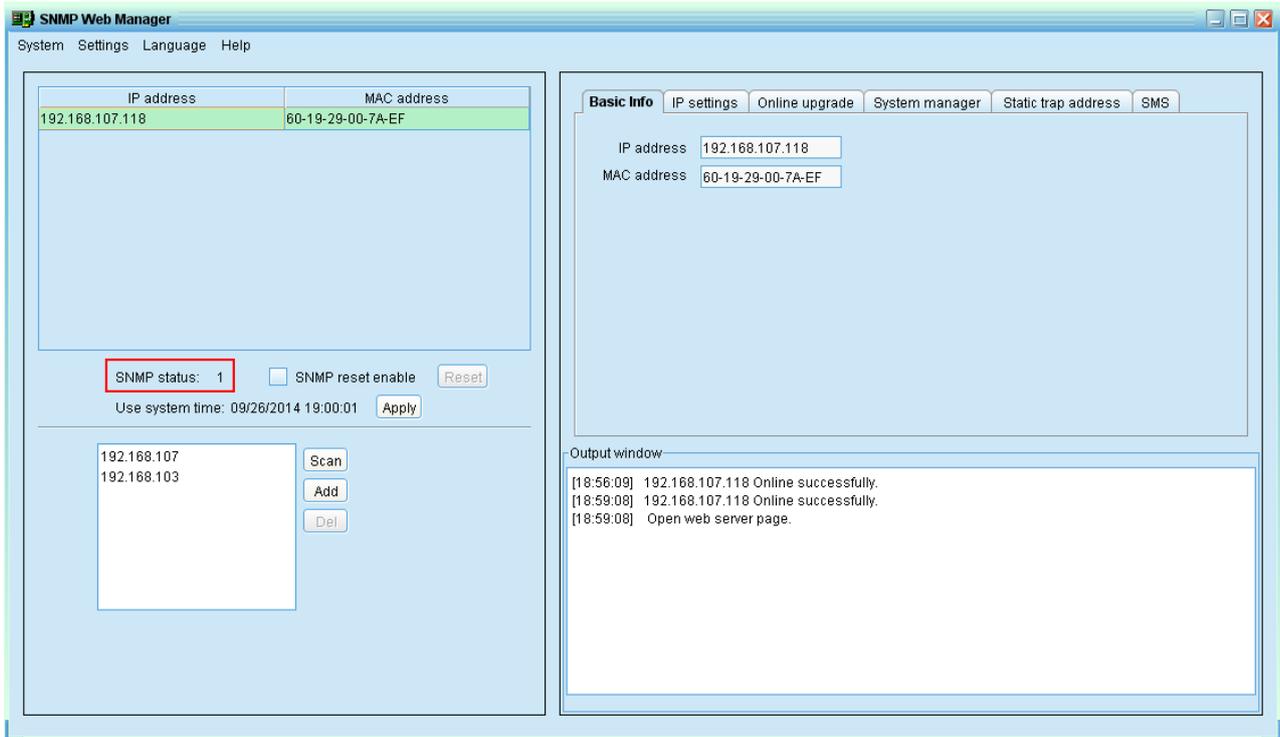


Diagram 3-5

3.7. Reset

If it is requested to restart the IP address of a device, please select "SNMP reset enable" and click on the "Reset" button. After confirming the login, you can restart the device. Steps are as follows:

Step1: Select IP address needed to restart from the IP list. Refer to Diagram 3-6.

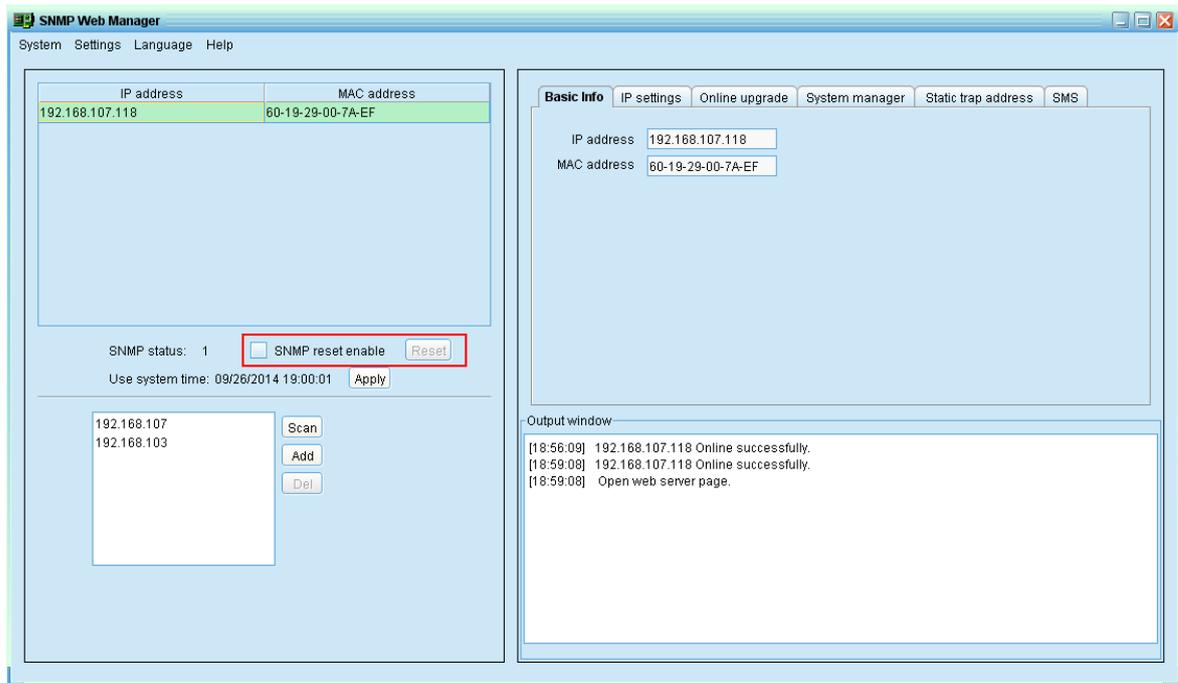


Diagram 3-6

Step2: Click the checkbox of "SNMP reset enable". Then, "Reset" button will be available for click.
Refer to Diagram 3-7.

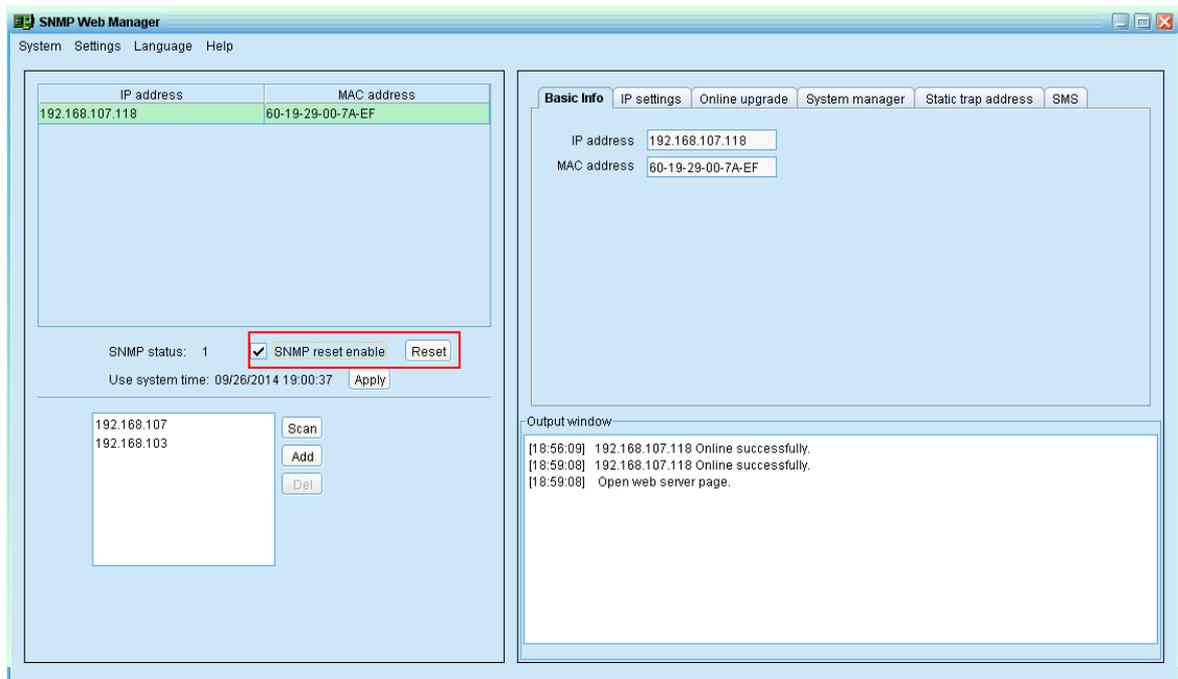


Diagram 3-7

Step3: Click "Reset" button and it will prompt dialog to confirm this operation. Refer to Diagram 3-8.

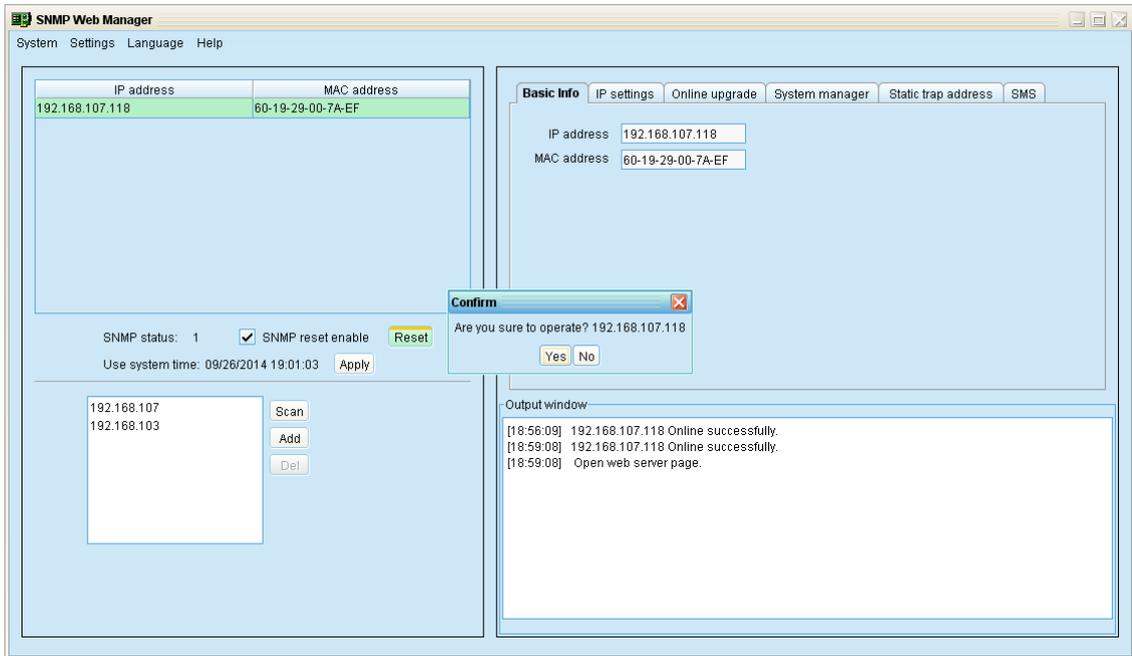


Diagram 3-8

Step4: Click "Yes" button and it will pop up a dialog to ask a login. If "No" is selected, this operation will be suspended. Refer to Diagram 3-9.

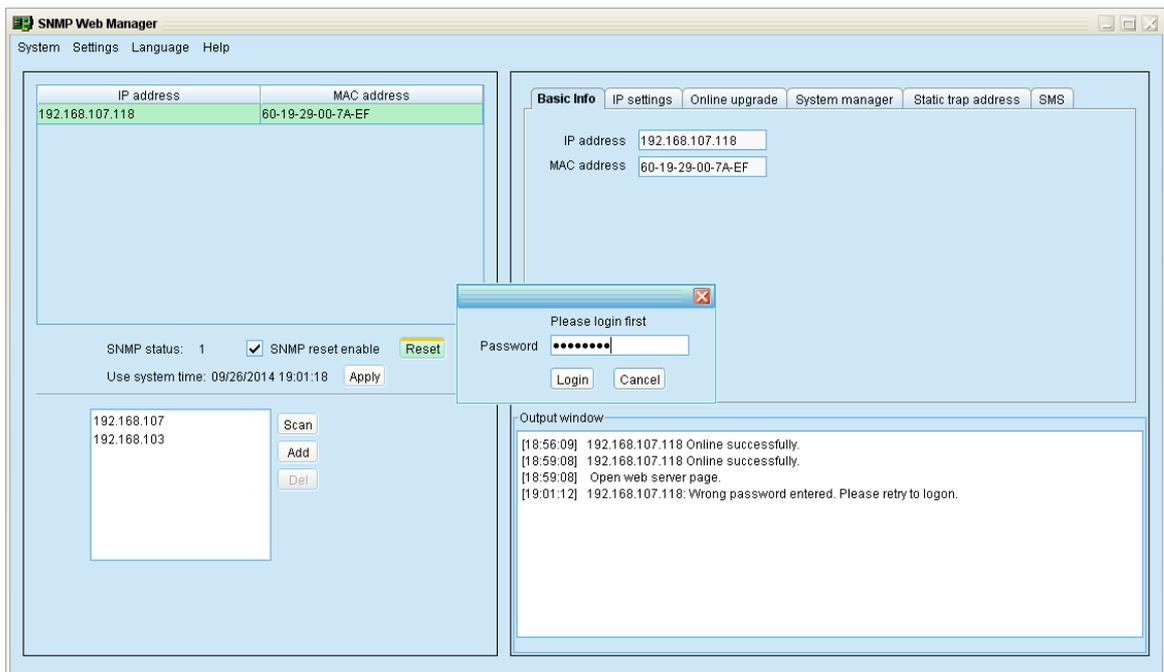


Diagram 3-9

Step5: Enter password and then click "Login" button. The target device will be restarted.

NOTE: If changing the MAC address of the current device before reboot and the current device is obtained by DHCP (Automatically obtain an IP address), you need to manually click "Scan" button to get an IP address after a reboot.

3.8. Use system time

If you select use system time, SNMP card will use PC system time. Refer to Diagram 3-10.

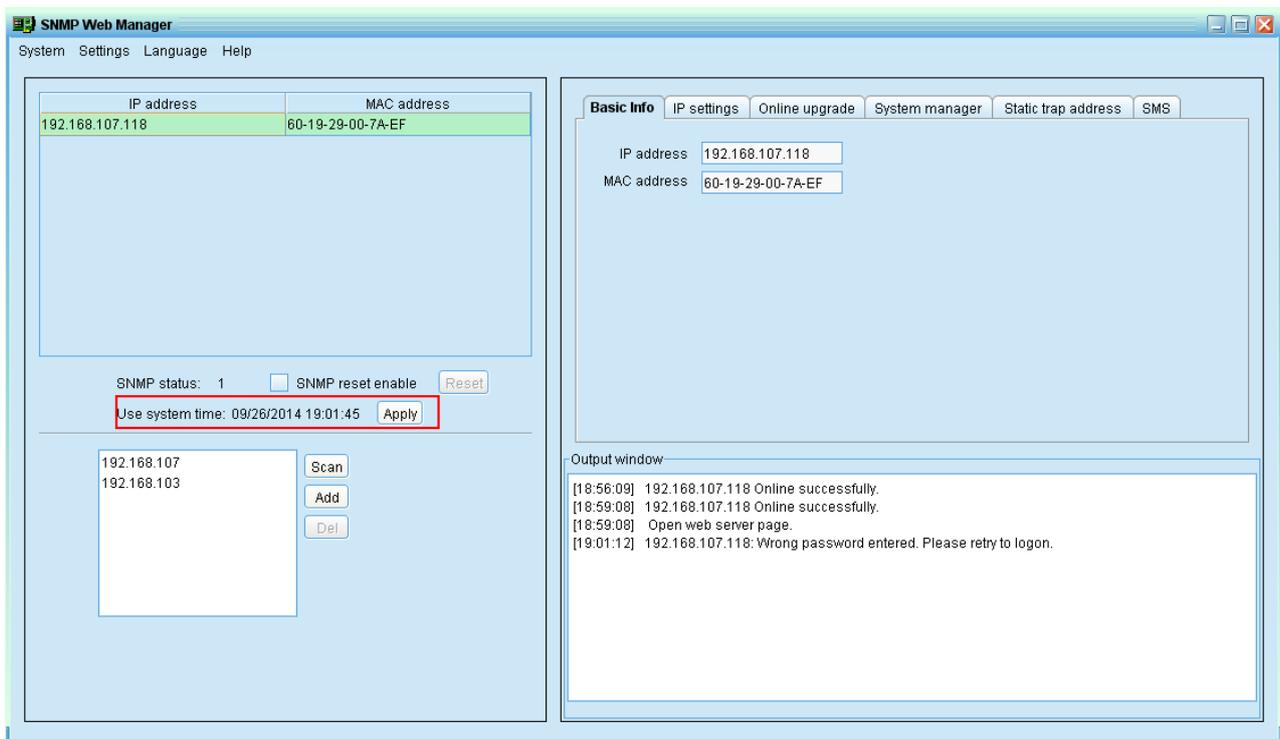


Diagram 3-10

4. SNMP Web Manager Function Menu

4.1 System

4.1.1 Quit

Select "Quick" to exit SNMP Web Manager.

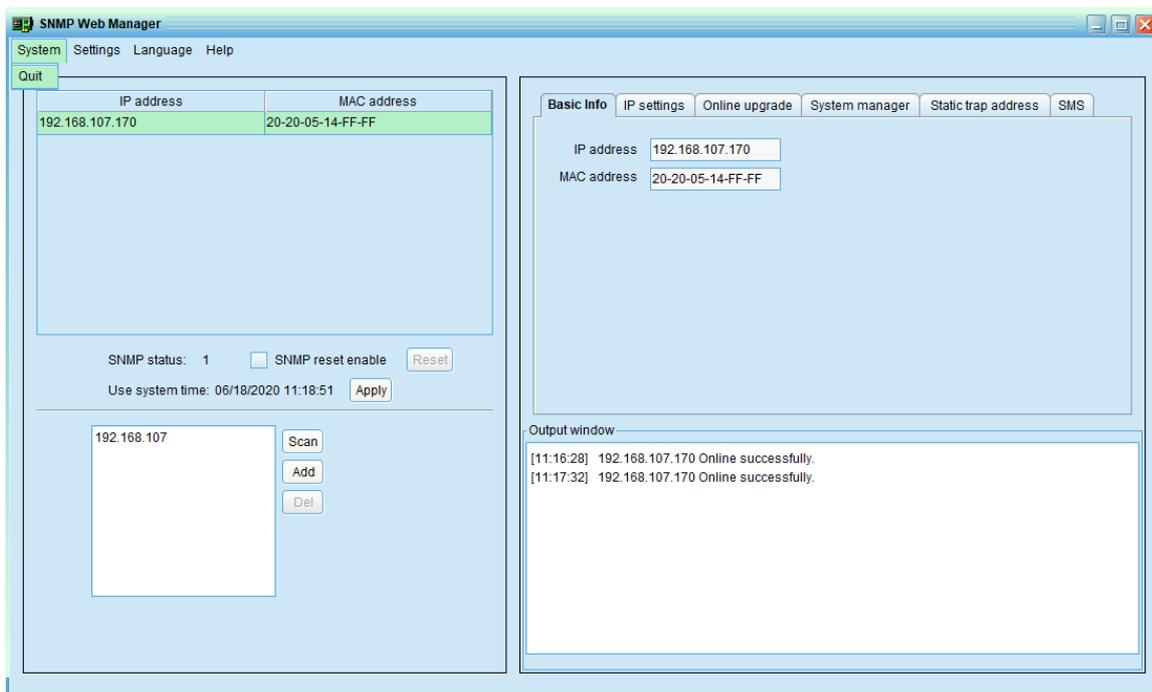


Diagram 4-1

4.2 Settings

4.2.1 Basic Info

Basic information displays IP address and Mac address. Refer to Diagram 4-2.

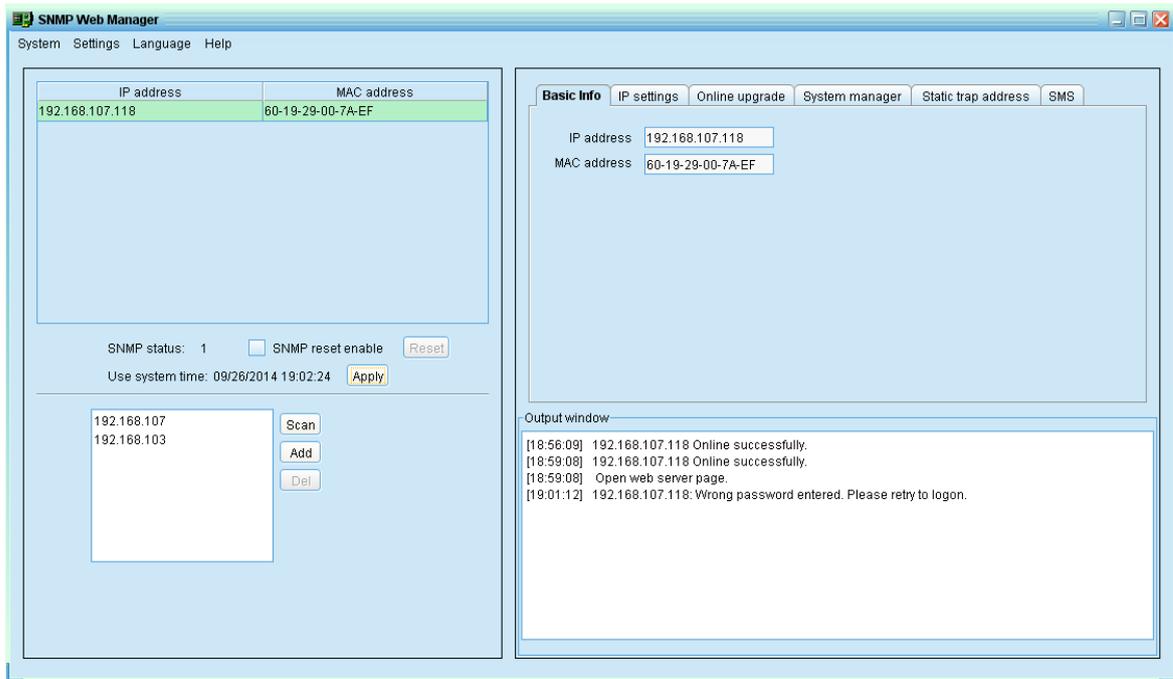


Diagram 4-2

4.2.2 IP Setting

Part 1: MAC address

Step : Select IP address from IP list. It will display MAC address of device in the output window.

Refer to Diagram 4-3.

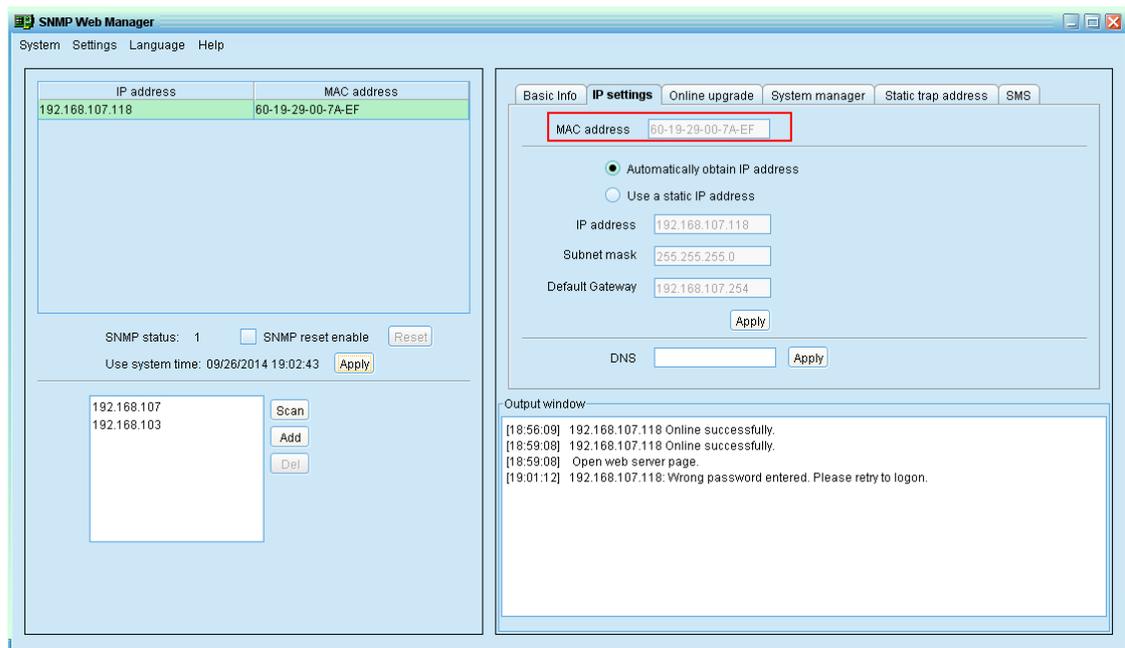


Diagram 4-3

Part 2: There are two methods to obtain IP address:

- Automatically obtain IP address (DHCP)
- Manually configure IP address

The system will default automatically to obtain IP addresses. If there is no this kind of service provided in LAN, the default IP will display as “192.168.102.230”, Netmask as “255.255.255.0” and default gateway as “0.0.0.0”. Refer to Diagram 4-4.

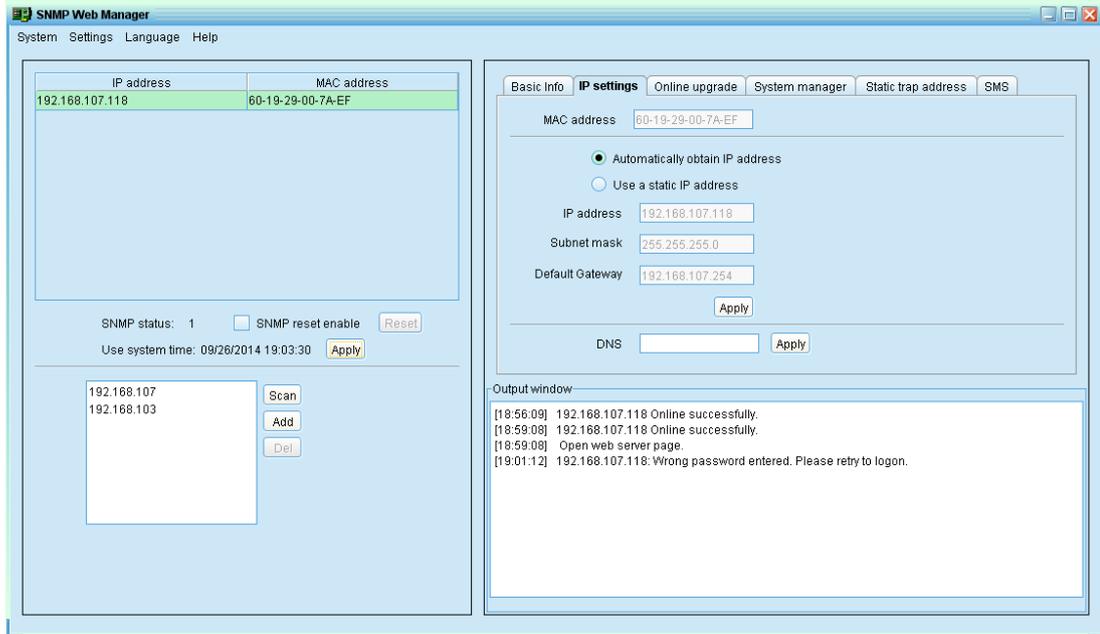


Diagram 4-4

Part 3: DNS setting:

Enter the DNS and then click “Apply” button. Refer to Diagram 4-5.

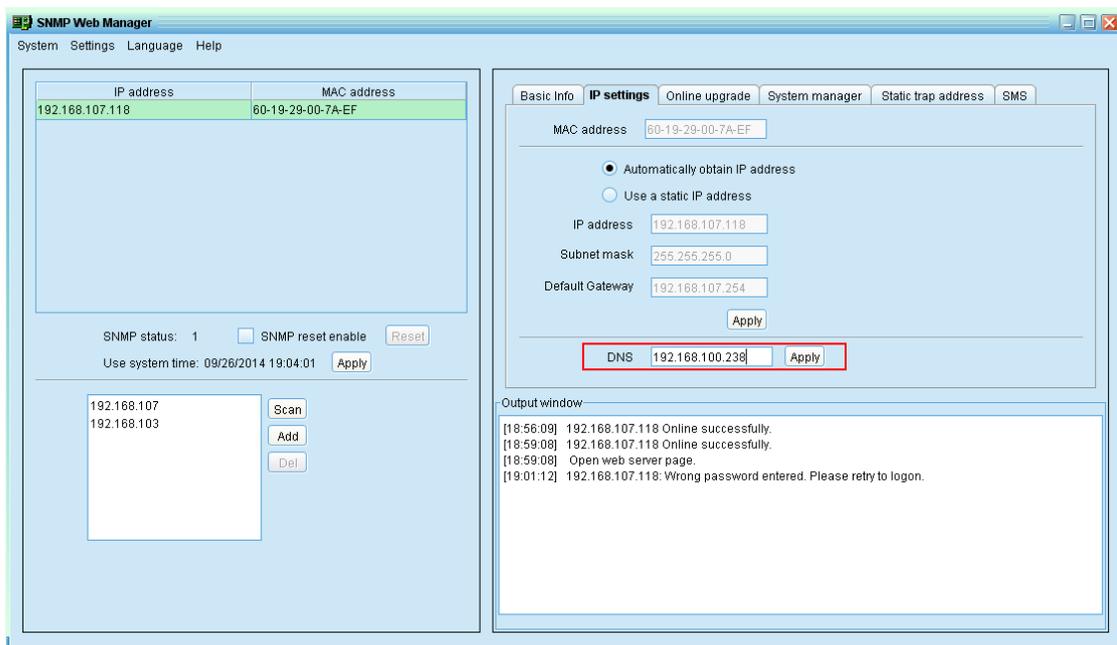


Diagram 4-5

4.2.3 Online upgrade

There are three methods for online upgrade:

- Upgrade the selected devices: It will upgrade all SNMP devices listed on the window.
- Upgrade all un-upgraded devices: It will only upgrade SNMP devices that are not using the same version as the current SNMP device is.
- Force to upgrade all devices: No matter what kinds of versions are used for SNMP devices listed in the window list, it will upgrade all devices to the latest version used in the current SNMP device. Refer to Diagram 4-6.

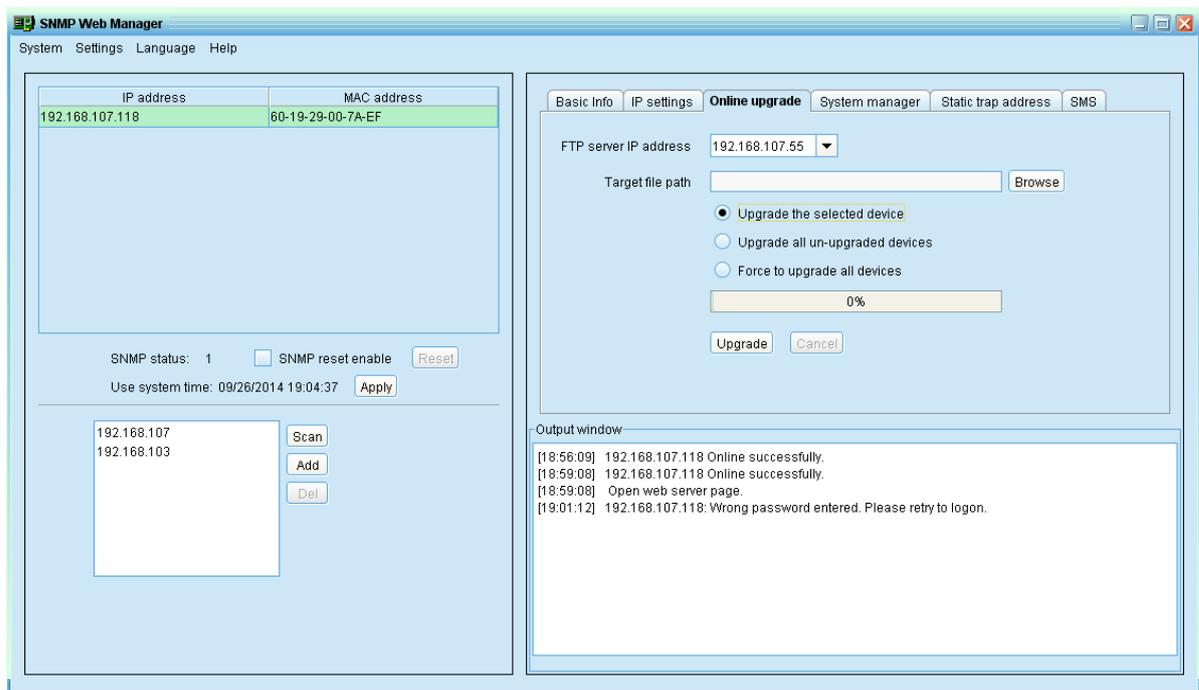


Diagram 4-6

Step 1: select the FTP server IP address. Refer to Diagram 4-6.

NOTE: If applying upgrade for SNMP Web Server in LAN, FTP server IP address will be IP address of current PC in LAN. If applying upgrade for SNMP Web Server in specific networking, FTP server IP address will be IP address of current PC in Internet.

Step 2: Click "Browse" button to choose program file. Refer to Diagram 4-7.

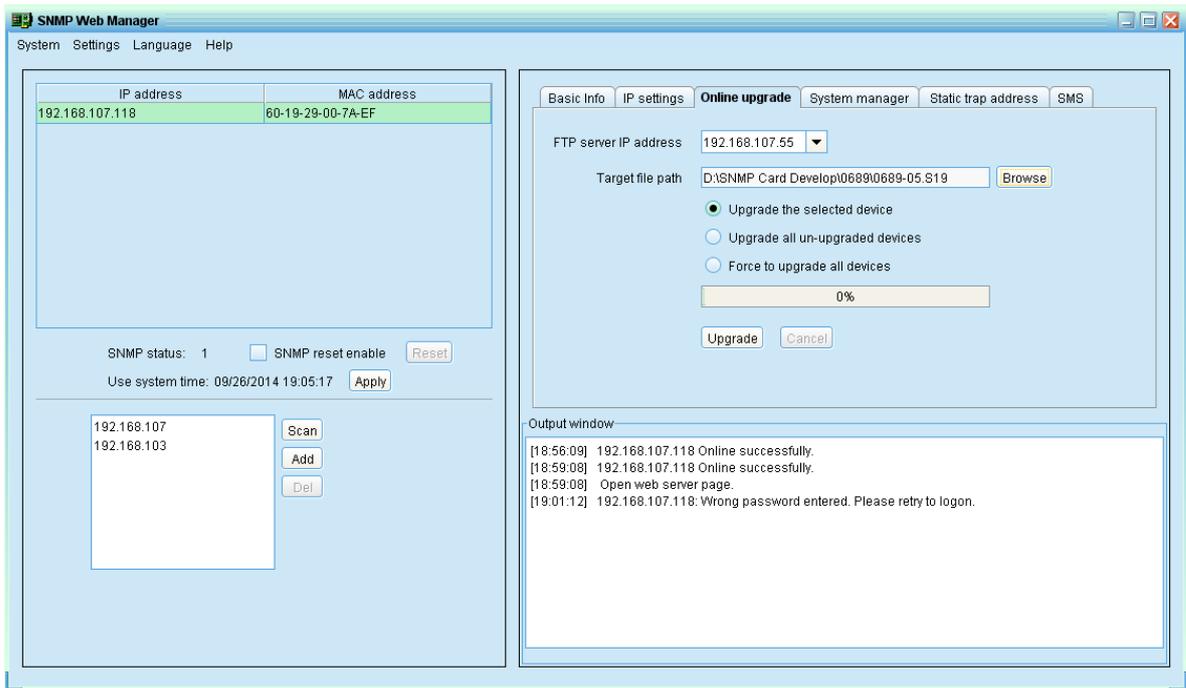


Diagram 4-7

Step 3: Click "Upgrade" button to execute upgrade action. Refer to Diagram 4-8.

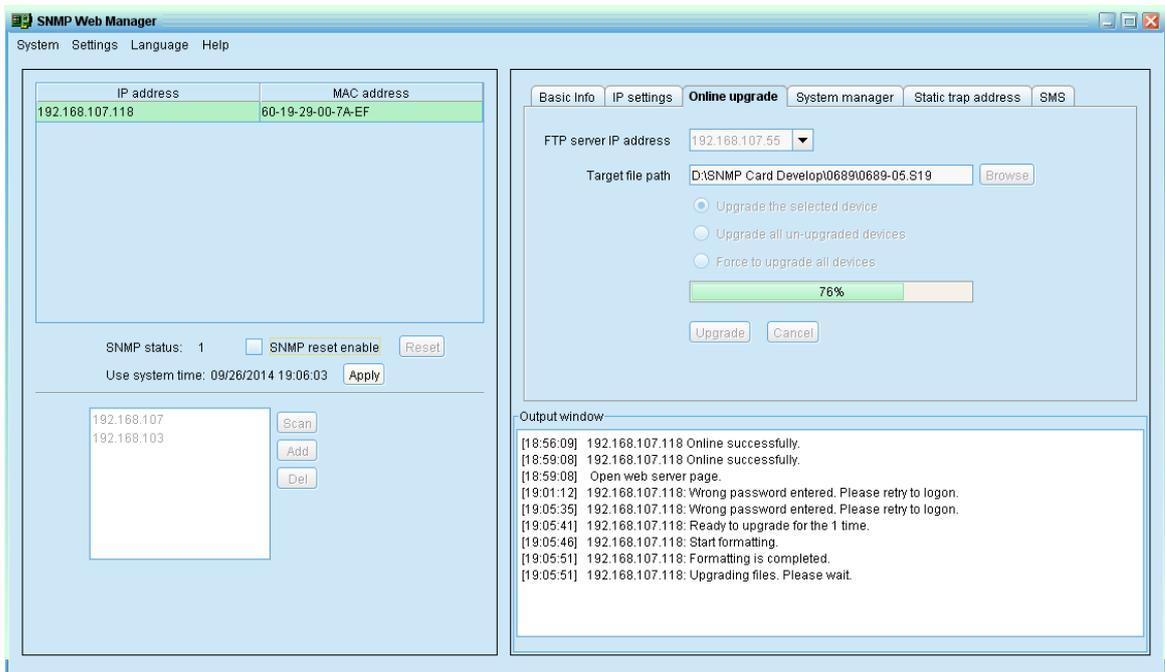


Diagram 4-8

Step 4: When upgrade is complete, you may check the message in output window. Refer to Diagram 4-9.

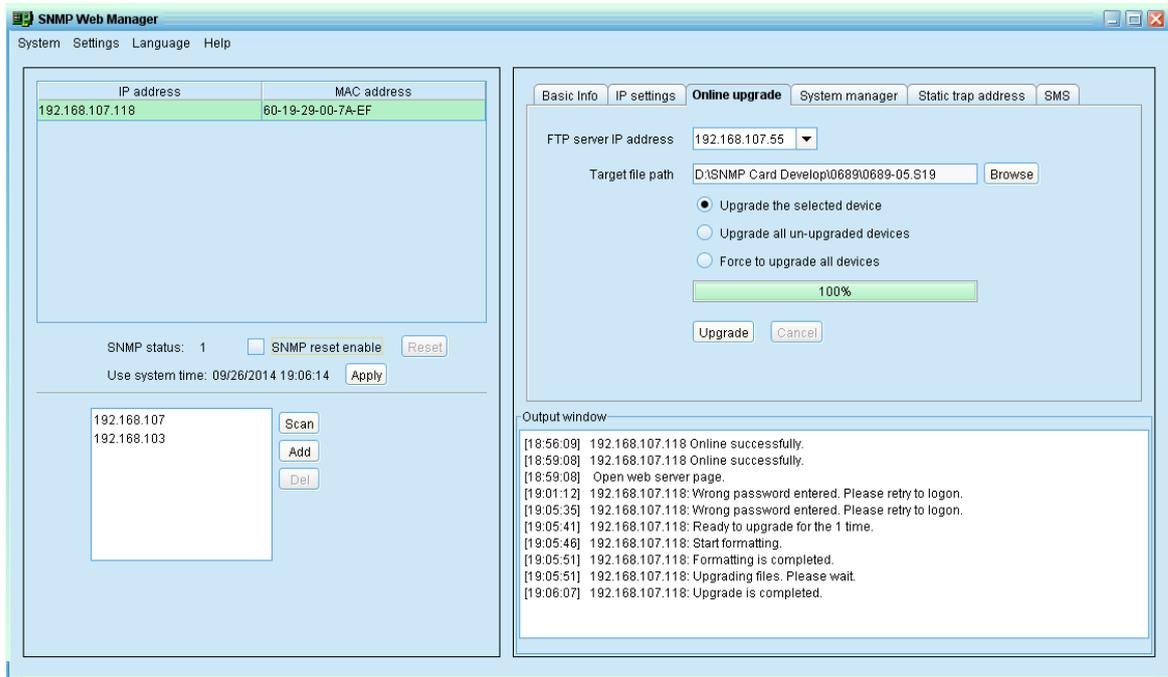


Diagram 4-9

NOTE: If abnormal situation occurs during upgrade process, the system will automatically re-start the upgrade operation. If this interruption occurs five times, system will automatically stop this operation. At this time, please check if LAN is working fine or not.

4.2.4 System manager

You may modify single password for one SNMP device or all passwords for all SNMP devices. Refer to Diagram 4-10

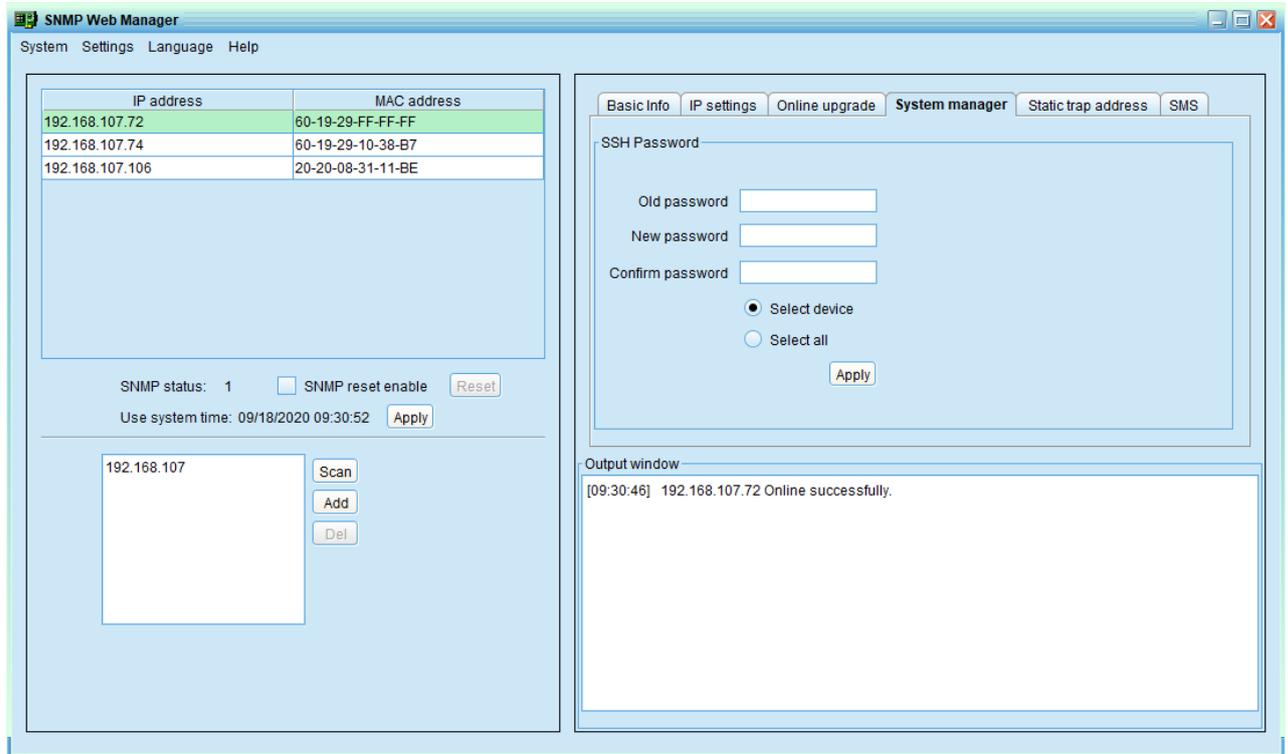


Diagram 4-10

You can modify password.

- Select device: Choose to change password for selected SNMP device on the window list.
- Select all: Choose to change passwords for all SNMP devices on the window list

Enter original password, new password and re-enter new password to confirm. Then, click "Apply" button to apply password change.

NOTE: The length of password is 8~15 digits. If this password change is applied for all SNMP devices, all SNMP devices passwords must be consistent.

4.2.5 Static trap address

You may configure two static trap addresses and change trap port in SNMP Web Manager. The default trap port is 162. Refer to Diagram 4-11.

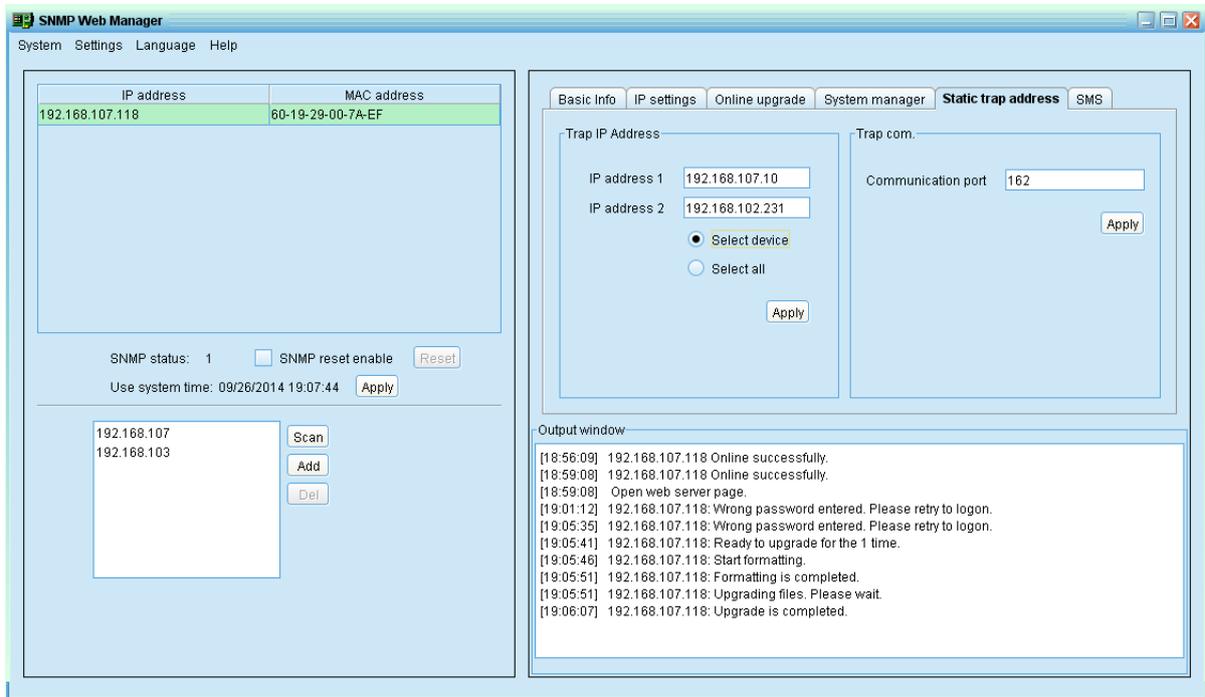


Diagram 4-11

NOTE: The SNMP device could provide 2 static trap addresses and 8 dynamic trap addresses. The SNMP device will automatically obtain IP address of host machine which installed monitoring software as dynamic trap address. If one of dynamic trap address is inactive for over 10 minutes, SNMP device will automatically release it and obtain a new dynamic trap address.

4.2.6 SMS Configuration

It's for entering SMS recipient list. In the event of an alarm condition occurring, a message about UPS status will be sent to the specified users via mobile phone.

Step 1 Select SMS. Refer to Diagram 4-12.

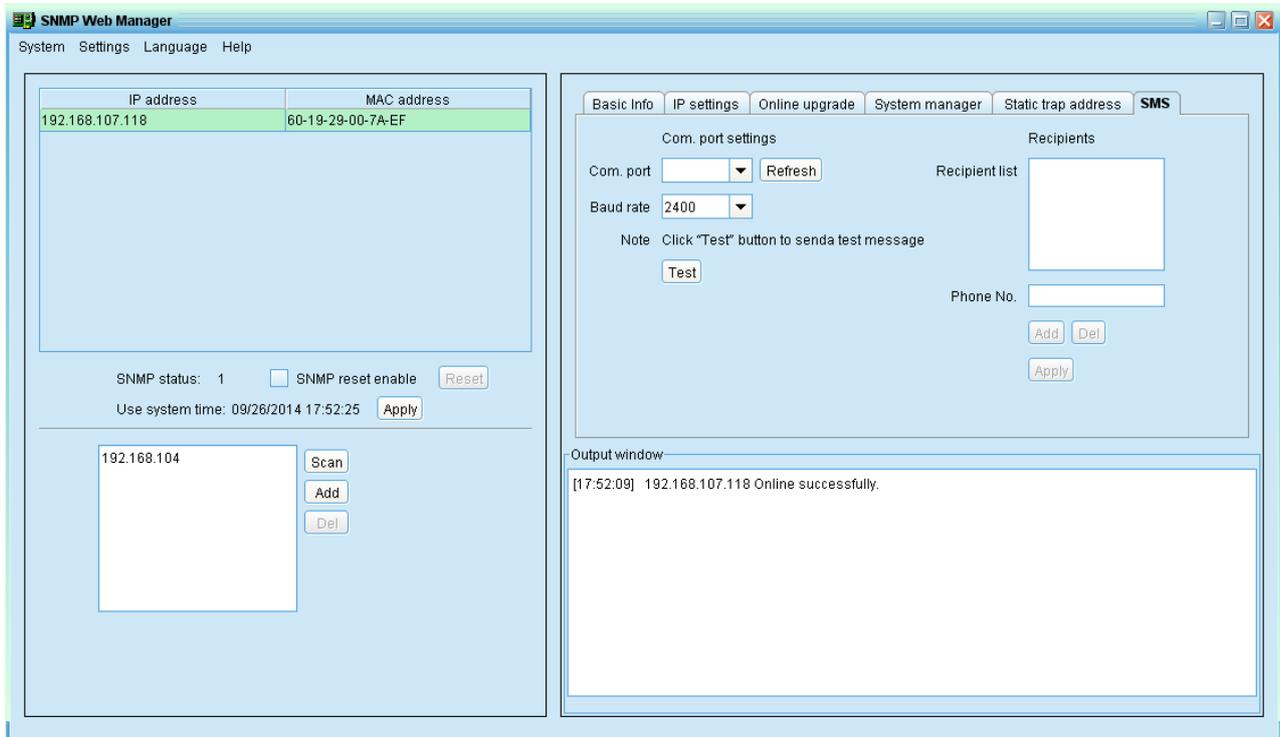


Diagram 4-12

Step 2 Select communication port and baud rate.

Step 3 Enter mobile phone numbers in "Phone no." column and click "Add" button to add phone no. in Recipients. To delete numbers, simply select phone no. from "Recipients" and click "Del" button.

Step 4 Click "Apply" button to save all changes. The "Test" button can be used to send a test SMS to confirm the correct setting in GSM modem. If all parameters are set up correctly, system will send a test message to all receivers and pop up a successful message. (Refer to Diagram 4-13) Otherwise, it will pop up a failure dialog to indicate there is an error for parameter setting. (Refer to Diagram 4-14)

NOTE: This SMS setting is for testing only. Be sure to enter all settings in SMS page of SNMP Web Pro or ViewPower Pro software. For the detailed settings, please check section 3.4.3 in SNMP web pro manual or 5.8.4 in ViewPower Pro software manual.

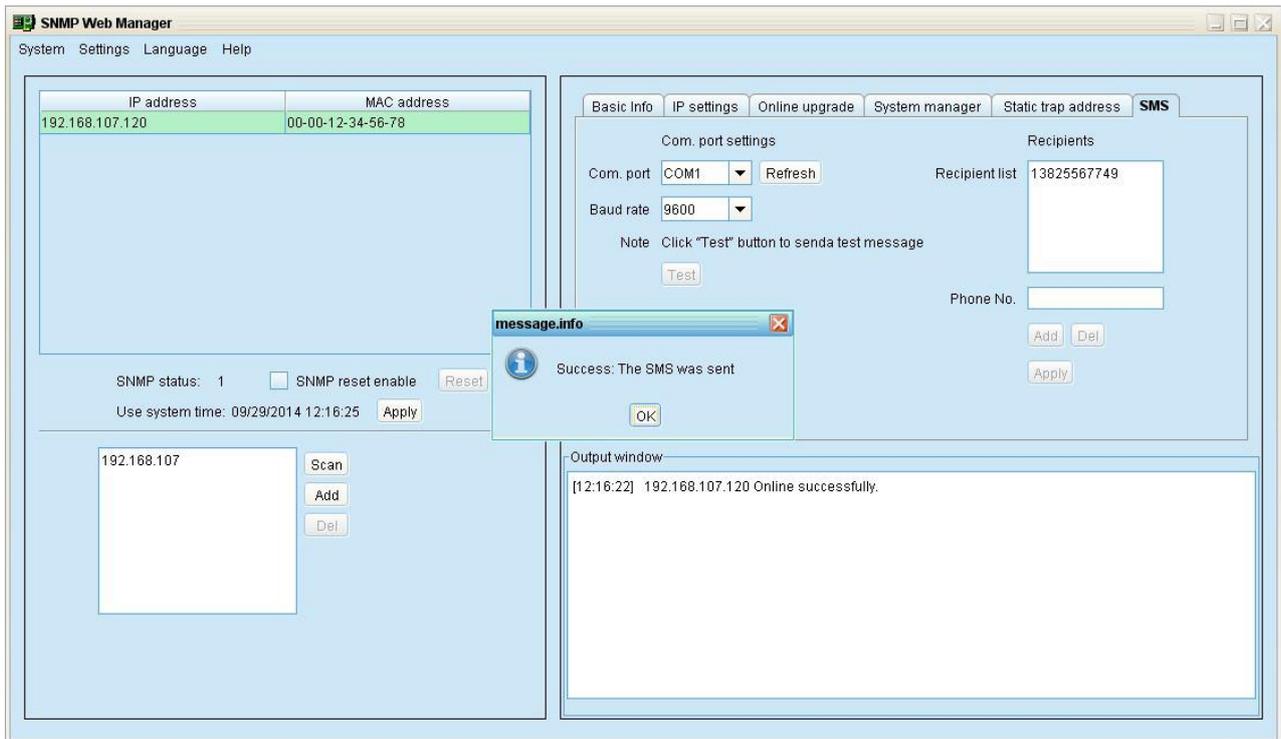


Diagram 4-13

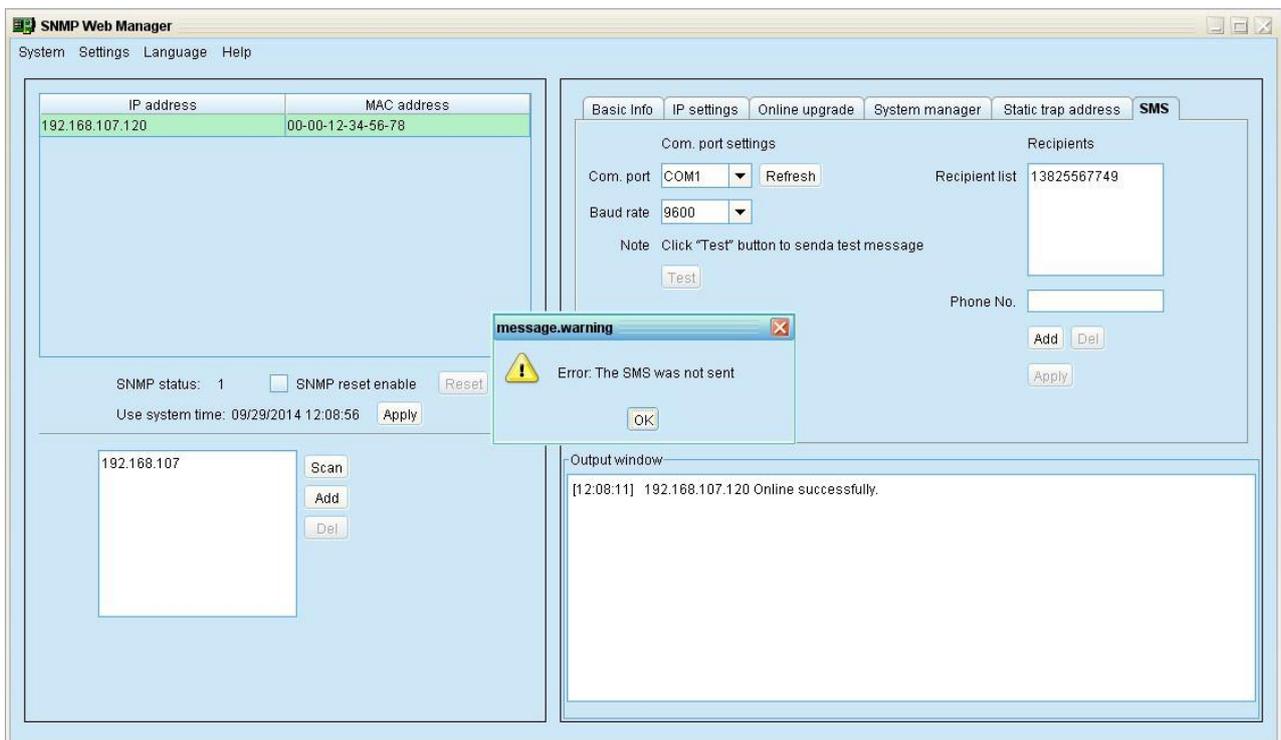


Diagram 4-14

After setting in SNMP web manager, it's necessary to configure SMS setting in SNMP Web Pro (section 3.4.3) or ViewPower Pro (section 5.8.4) to complete this function.

Step 5 Please open SNMP Web Pro and select "Event action". Click checkbox of "Send SMS while any UPS's event occurs". Please refer to Diagram 4-15.

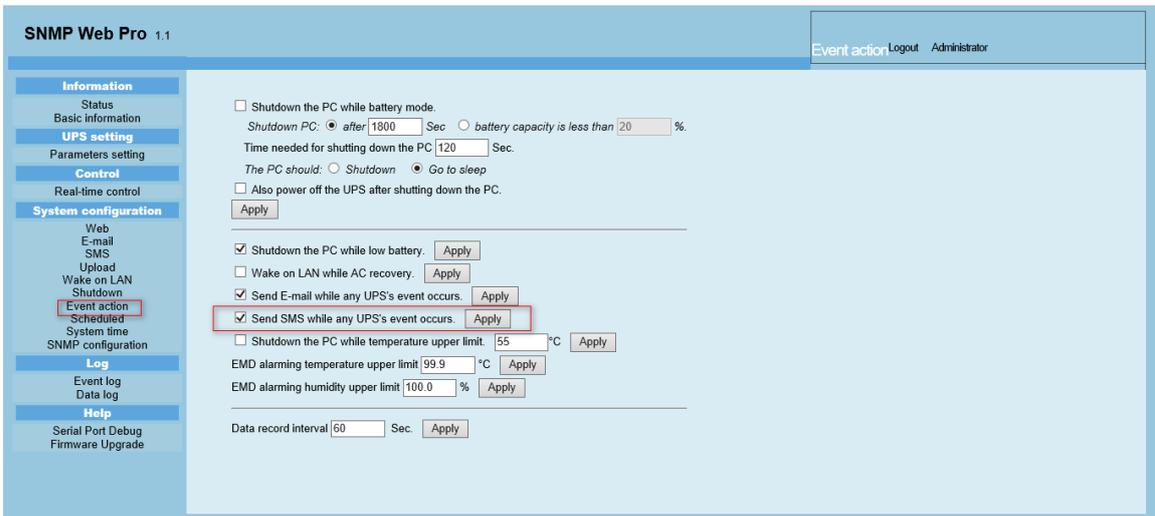


Diagram 4-15

Step 6 Then, select "SMS" and configure the setting as the following. Refer to Diagram 4-16.

- Enter the IP address of the server with SNMP Web Manager installed.
- Set up SMS receiver port from SNMP Web Manager: 41222 .
- Set up the user name of the SNMP card as root.
- Set up a password to access the SNMP card. It's the same password setting in SNMP Web Pro.
- Enter the mobile phone number to receive SMS.

After all, steps are complete, click "Apply" button to confirm the modifications. You may click "Test" button to do the test. At this time, if any event occurs on the UPS, the SNMP card will send a short message through the COM port setting in SNMP Web Manager to all receivers listed in Area E in Diagram 4-16.

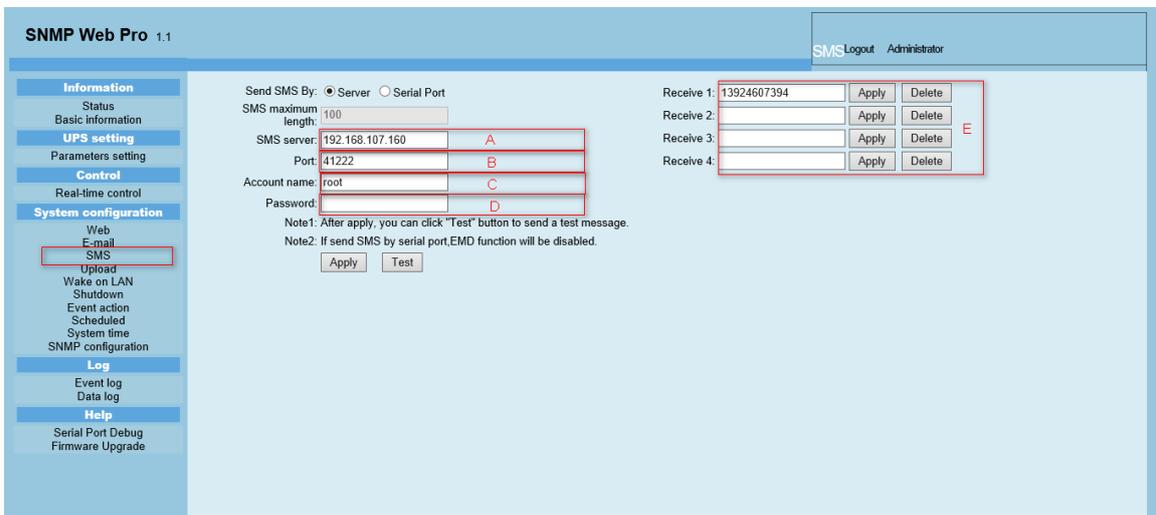


Diagram 4-16

NOTE: It's required to plug-in GSM Modem if sending SMS to mobile phone.

4.3 Language

SNMP Web Manager offers 12 languages:

- ✓ Chinese(Simplified)
- ✓ Chinese(Traditional)
- ✓ English
- ✓ German
- ✓ Italian
- ✓ Polish
- ✓ Portuguese
- ✓ Russian
- ✓ Spanish
- ✓ Turkish
- ✓ Ukrainian
- ✓ French

The default language setting would be English.

4.4 Help

- **About:** Click "Help" menu and select "About" item. It represents the copyright information about software
- **Help:** Click "Help" menu and select "System help" item. It will open the help manual. Before operating software, please read manual carefully.